


# PREDICTED ENERGY ASSESSMENT

032, 3 Bed,  
K,B,WC,ES


Dwelling type: House, Semi-Detached  
Date of assessment: 31/01/2022  
Produced by: Henry Knight  
Total floor area: 111.26 m<sup>2</sup>

This document is a Predicted Energy Assessment for properties marketed when they are incomplete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, this rating will be updated and an official Energy Performance Certificate will be created for the property. This will include more detailed information about the energy performance of the completed property.

The energy performance has been assessed using the Government approved SAP2012 methodology and is rated in terms of the energy use per square meter of floor area; the energy efficiency is based on fuel costs and the environmental impact is based on carbon dioxide (CO<sub>2</sub>) emissions.

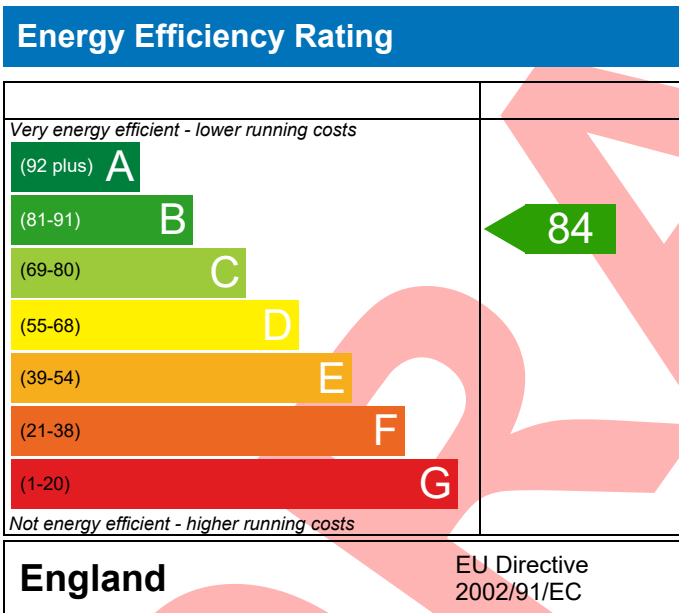

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

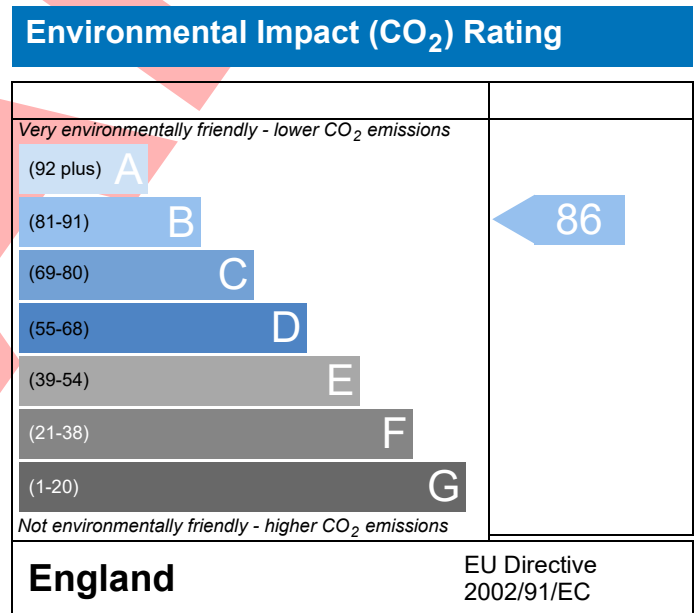

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO<sub>2</sub>) emissions. The higher the rating the less impact it has on the environment.

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)



Property Reference	U528-0001-6140-032	Issued on Date	31/01/2022
Assessment Reference	032	Prop Type Ref	303A Semi-H (OP)
Property	032, 3 Bed, K,B,WC,ES		

SAP Rating	84 B	DER	16.27	TER	16.35
Environmental	86 B	% DER<TER	0.48		
CO <sub>2</sub> Emissions (t/year)	1.56	DFEE	42.44	TFEE	52.08
General Requirements Compliance	Pass	% DFEE<TFEE	18.52		

Assessor Details	Mr. Henry Knight, Henry Knight, Tel: 01173183565, Henry.knight@aessc.co.uk	Assessor ID	U528-0001
Client	C G Fry & Son Ltd		

### SUMMARY FOR INPUT DATA FOR New Build (As Designed)

#### Criterion 1 – Achieving the TER and TFEE rate

##### 1a TER and DER

Fuel for main heating	Mains gas		
Fuel factor	1.00 (mains gas)		
Target Carbon Dioxide Emission Rate (TER)	16.35	kgCO <sub>2</sub> /m <sup>2</sup>	
Dwelling Carbon Dioxide Emission Rate (DER)	16.27	kgCO <sub>2</sub> /m <sup>2</sup>	Pass
	-0.08 (-0.5%)	kgCO <sub>2</sub> /m <sup>2</sup>	

##### 1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE)	52.08	kWh/m <sup>2</sup> /yr	
Dwelling Fabric Energy Efficiency (DFEE)	42.44	kWh/m <sup>2</sup> /yr	
	-9.7 (-18.6%)	kWh/m <sup>2</sup> /yr	Pass

#### Criterion 2 – Limits on design flexibility

##### Limiting Fabric Standards

##### 2 Fabric U-values

Element	Average	Highest	
External wall	0.19 (max. 0.30)	0.19 (max. 0.70)	Pass
Party wall	0.00 (max. 0.20)	-	Pass
Floor	0.14 (max. 0.25)	0.14 (max. 0.70)	Pass
Roof	0.09 (max. 0.20)	0.09 (max. 0.35)	Pass
Openings	1.40 (max. 2.00)	1.50 (max. 3.30)	Pass

##### 2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

##### 3 Air permeability

Air permeability at 50 pascals	4.50 (design value)	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	
Maximum	10.0	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	Pass

##### Limiting System Efficiencies

##### 4 Heating efficiency

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)

Main heating system	Boiler system with radiators or underfloor - Mains gas Data from database Vaillant ecoFIT sustain 615 VU 156/6-3 (H-GB)  Efficiency: 89.8% SEDBUK2009 Minimum: 88.0%	Pass
---------------------	---	------

Secondary heating system	Room heaters - electric Panel, convector or radiant heaters	
--------------------------	--	--

### 5 Cylinder insulation

Hot water storage	Measured cylinder loss: 1.80 kWh/day Permitted by DBSCG 1.89	Pass
-------------------	---	------

Primary pipework insulated	Yes	Pass
----------------------------	-----	------

### 6 Controls

Space heating controls	Time and temperature zone control	Pass
------------------------	-----------------------------------	------

Hot water controls	Cylinderstat	Pass
--------------------	--------------	------

	Independent timer for DHW	Pass
--	---------------------------	------

Boiler interlock	Yes	Pass
------------------	-----	------

### 7 Low energy lights

Percentage of fixed lights with low-energy fittings	100	%	
---	-----	---	--

Minimum	75	%	Pass
---------	----	---	------

### 8 Mechanical ventilation

Continuous extract system (decentralised)			
---	--	--	--

Specific fan power	0.1600 0.1700		
--------------------	---------------	--	--

Maximum	0.7		Pass
---------	-----	--	------

## Criterion 3 – Limiting the effects of heat gains in summer

### 9 Summertime temperature

Overheating risk (Severn Valley)	Slight	Pass
----------------------------------	--------	------

Based on:

Overshading	Average
-------------	---------

Windows facing North East	9.52 m <sup>2</sup> , No overhang
---------------------------	-----------------------------------

Windows facing South West	9.45 m <sup>2</sup> , No overhang
---------------------------	-----------------------------------

Air change rate	4.00 ach
-----------------	----------

Blinds/curtains	None
-----------------	------

## Criterion 4 – Building performance consistent with DER and DFEE rate

### Party Walls

Type	U-value	W/m <sup>2</sup> K	
Filled Cavity with Edge Sealing	0.00		Pass

### Air permeability and pressure testing

#### 3 Air permeability

Air permeability at 50 pascals	4.50 (design value)	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	
--------------------------------	---------------------	---	--

Maximum	10.0	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	Pass
---------	------	---	------

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)



### 10 Key features

Party wall U-value	0.00	W/m <sup>2</sup> K
Roof U-value	0.09	W/m <sup>2</sup> K
Thermal bridging $\psi$ -value	0.039	W/m <sup>2</sup> K
Secondary heating (electricity)	N/A	

DRAFT

*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*

# RECOMMENDATIONS

	Typical cost	Typical savings per year	Energy efficiency	Environmental impact	Result
Low energy lights			0	0	Already installed
Solar water heating	£4,000 - £6,000	£40	B 86	B 88	Recommended
Photovoltaic	£3,500 - £5,500	£349	A 94	A 96	Recommended
Wind turbine			0	0	Not applicable
<b>Totals</b>	<b>£7,500 - £11,500</b>	<b>£389</b>	<b>A 94</b>	<b>A 96</b>	

**DRAFT**

*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*